



Sun Fire™ V1280/Netra™ 1280 Systems Site Planning Guide

Sun Microsystems, Inc.
www.sun.com

Part No. 817-3333-11
June 2006, Revision A

Submit comments about this document at: <http://www.sun.com/hwdocs/feedback>

Copyright 2006 Sun Microsystems, Inc., 4150 Network Circle, Santa Clara, California 95054, U.S.A. All rights reserved.

Sun Microsystems, Inc. has intellectual property rights relating to technology that is described in this document. In particular, and without limitation, these intellectual property rights may include one or more of the U.S. patents listed at <http://www.sun.com/patents> and one or more additional patents or pending patent applications in the U.S. and in other countries.

This document and the product to which it pertains are distributed under licenses restricting their use, copying, distribution, and decompilation. No part of the product or of this document may be reproduced in any form by any means without prior written authorization of Sun and its licensors, if any.

Third-party software, including font technology, is copyrighted and licensed from Sun suppliers.

Parts of the product may be derived from Berkeley BSD systems, licensed from the University of California. UNIX is a registered trademark in the U.S. and in other countries, exclusively licensed through X/Open Company, Ltd.

Sun, Sun Microsystems, the Sun logo, AnswerBook2, docs.sun.com, Sun Fire, Sun StorEdge, Netra, and Solaris are trademarks or registered trademarks of Sun Microsystems, Inc. in the U.S. and in other countries.

All SPARC trademarks are used under license and are trademarks or registered trademarks of SPARC International, Inc. in the U.S. and in other countries. Products bearing SPARC trademarks are based upon an architecture developed by Sun Microsystems, Inc.

The OPEN LOOK and Sun™ Graphical User Interface was developed by Sun Microsystems, Inc. for its users and licensees. Sun acknowledges the pioneering efforts of Xerox in researching and developing the concept of visual or graphical user interfaces for the computer industry. Sun holds a non-exclusive license from Xerox to the Xerox Graphical User Interface, which license also covers Sun's licensees who implement OPEN LOOK GUIs and otherwise comply with Sun's written license agreements.

U.S. Government Rights—Commercial use. Government users are subject to the Sun Microsystems, Inc. standard license agreement and applicable provisions of the FAR and its supplements.

DOCUMENTATION IS PROVIDED "AS IS" AND ALL EXPRESS OR IMPLIED CONDITIONS, REPRESENTATIONS AND WARRANTIES, INCLUDING ANY IMPLIED WARRANTY OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE OR NON-INFRINGEMENT, ARE DISCLAIMED, EXCEPT TO THE EXTENT THAT SUCH DISCLAIMERS ARE HELD TO BE LEGALLY INVALID.

Copyright 2006 Sun Microsystems, Inc., 4150 Network Circle, Santa Clara, Californie 95054, Etats-Unis. Tous droits réservés.

Sun Microsystems, Inc. a les droits de propriété intellectuels relatants à la technologie qui est décrit dans ce document. En particulier, et sans la limitation, ces droits de propriété intellectuels peuvent inclure un ou plus des brevets américains énumérés à <http://www.sun.com/patents> et un ou les brevets plus supplémentaires ou les applications de brevet en attente dans les Etats-Unis et dans les autres pays.

Ce produit ou document est protégé par un copyright et distribué avec des licences qui en restreignent l'utilisation, la copie, la distribution, et la décompilation. Aucune partie de ce produit ou document ne peut être reproduite sous aucune forme, par quelque moyen que ce soit, sans l'autorisation préalable et écrite de Sun et de ses bailleurs de licence, s'il y en a.

Le logiciel détenu par des tiers, et qui comprend la technologie relative aux polices de caractères, est protégé par un copyright et licencié par des fournisseurs de Sun.

Des parties de ce produit pourront être dérivées des systèmes Berkeley BSD licenciés par l'Université de Californie. UNIX est une marque déposée aux Etats-Unis et dans d'autres pays et licenciée exclusivement par X/Open Company, Ltd.

Sun, Sun Microsystems, le logo Sun, AnswerBook2, docs.sun.com, Sun Fire, Sun StorEdge, Netra, et Solaris sont des marques de fabrique ou des marques déposées de Sun Microsystems, Inc. aux Etats-Unis et dans d'autres pays.

Toutes les marques SPARC sont utilisées sous licence et sont des marques de fabrique ou des marques déposées de SPARC International, Inc. aux Etats-Unis et dans d'autres pays. Les produits portant les marques SPARC sont basés sur une architecture développée par Sun Microsystems, Inc.

L'interface d'utilisation graphique OPEN LOOK et Sun™ a été développée par Sun Microsystems, Inc. pour ses utilisateurs et licenciés. Sun reconnaît les efforts de pionniers de Xerox pour la recherche et le développement du concept des interfaces d'utilisation visuelle ou graphique pour l'industrie de l'informatique. Sun détient une licence non exclusive de Xerox sur l'interface d'utilisation graphique Xerox, cette licence couvrant également les licenciées de Sun qui mettent en place l'interface d'utilisation graphique OPEN LOOK et qui en outre se conforment aux licences écrites de Sun.

LA DOCUMENTATION EST FOURNIE "EN L'ÉTAT" ET TOUTES AUTRES CONDITIONS, DECLARATIONS ET GARANTIES EXPRESSES OU TACITES SONT FORMELLEMENT EXCLUES, DANS LA MESURE AUTORISEE PAR LA LOI APPLICABLE, Y COMPRIS NOTAMMENT TOUTE GARANTIE IMPLICITE RELATIVE A LA QUALITE MARCHANDE, A L'APTITUDE A UNE UTILISATION PARTICULIERE OU A L'ABSENCE DE CONTREFAÇON.



Please
Recycle



Adobe PostScript

Contents

Preface vii

- 1. Site Planning Checklist 1-1**
 - 1.1 System Packaging 1-1
 - 1.1.1 After Unpacking 1-1
 - 1.2 Site Planning Checklist 1-2
 - 1.2.1 Training 1-2
 - 1.2.2 System Components 1-2
 - 1.2.3 Physical Specifications 1-2
 - 1.2.4 Environmental Requirements 1-2
 - 1.2.5 Facility Power Requirements 1-2

- 2. Physical Specifications 2-1**
 - 2.1 Dimensions 2-1
 - 2.2 Mounting Requirements 2-3
 - 2.2.1 Vertical Space 2-4
 - 2.2.2 Depth 2-4
 - 2.2.3 Loading 2-5
 - 2.2.4 Safety 2-5
 - 2.3 Service Access 2-6

- 2.4 Seismic Applications 2–6

- 3. Environmental and Electrical Specifications 3–1**
 - 3.1 Environmental Requirements 3–1
 - 3.1.1 Ambient Temperature 3–2
 - 3.1.2 Ambient Relative Humidity 3–3
 - 3.2 Airflow and Heat Dissipation 3–3
 - 3.3 Sun Fire V1280 System Power Requirements 3–4
 - 3.3.1 Grounding Requirements 3–5
 - 3.3.2 Connecting AC Power for Redundancy 3–6
 - 3.4 Netra 1280 System Power Requirements 3–6
 - 3.4.1 Source Site Requirements 3–8
 - 3.4.1.1 Grounding Requirements 3–8
 - 3.4.1.2 Overcurrent Protection Requirements 3–9
 - 3.4.1.3 Disconnection and Isolation 3–9
 - 3.4.2 Connecting DC Power for Redundancy 3–9

Tables

TABLE 2-1	System Dimensions	2–2
TABLE 3-1	Environmental Limits for Sun Fire V1280/Netra 1280 Systems	3–2
TABLE 3-2	Heat Dissipation	3–3
TABLE 3-4	Sun Fire V1280 System Power Requirements	3–5
TABLE 3-5	Sun Fire V1280 System Current and Power Consumption	3–5
TABLE 3-3	Sun Fire V1280 System AC Power Cord Ratings	3–5
TABLE 3-6	Netra 1280 System DC Feed Pair Ratings	3–7
TABLE 3-7	Netra 1280 System Current and Power Consumption	3–7

Preface

This guide describes the physical and environmental requirements for Sun Fire™ V1280/Netra™ 1280 systems.

How This Book Is Organized

[Chapter 1](#) contains packing information and a site planning checklist.

[Chapter 2](#) describes the physical requirements.

[Chapter 3](#) describes the environmental requirements.

Related Documentation

TABLE P-1 Related Documentation

Application	Title
Safety	<i>Sun Fire V1280/Netra 1280 Systems Compliance and Safety Manual</i>
Use	<i>Sun Fire V1280/Netra 1280 System Administration Guide</i>
Use	<i>Sun Fire V1280/Netra 1280 System Controller Command Reference Manual</i>
Install	<i>Sun Fire V1280/Netra 1280 Systems Installation Guide</i>
Service	<i>Sun Fire V1280/Netra 1280 Systems Service Manual</i>

Accessing Sun Documentation

You can view, print, or purchase a broad selection of Sun documentation, including localized versions, at:

<http://www.sun.com/documentation>

Contacting Sun Technical Support

If you have technical questions about this product that are not answered in this document, go to:

<http://www.sun.com/service/contacting>

Sun Welcomes Your Comments

Sun is interested in improving its documentation and welcomes your comments and suggestions. You can submit your comments by going to:

<http://www.sun.com/hwdocs/feedback>

Please include the title and part number of your document with your feedback:

Sun Fire V1280/Netra 1280 Systems Site Planning Guide, part number 817-3333-11

Tools Required For Installation and Service

The following tools are required for installation and service. They should be safely stored and made readily available for service providers when required:

- Installation tools:
 - Computer lifting device
 - Screwdriver, Phillips no. 2
 - 13 mm wrench (spanner, supplied)
 - 8 mm wrench (spanner, supplied)
 - Torque wrench and extension bar (Netra 1280 system only, supplied)
 - M5 nut spinner (Netra 1280 system only, supplied)
 - Crimp connectors 1-hole (Netra 1280 system only, supplied)
 - Crimp connectors 2-hole (Netra 1280 system only, supplied)
- Service tools:
 - Screwdriver, Phillips no. 2
 - Needle nose pliers
 - ESD mat
 - ESD grounding wrist strap or foot strap
 - Compressor (Netra 1280 system)
 - Air hose (Netra 1280 system)
 - Safety platform

Site Planning Checklist

This chapter describes system requirements and the contents of the Sun Fire V1280/Netra 1280 systems shipping package. The chapter contains the following sections:

- [Section 1.1, “System Packaging” on page 1-1](#)
- [Section 1.2, “Site Planning Checklist” on page 1-2](#)

1.1 System Packaging

Sun Fire V1280/Netra 1280 systems are shipped secured to a wooden pallet by brackets. The system is covered by shock-resistant packaging secured by a corrugated cardboard cover, which itself is secured by unbreakable straps.

Graphics on the outside of the cover illustrate how to remove the cover and associated packaging. No special tools are required.

The modules shipped within the system depend on the configuration ordered.

1.1.1 After Unpacking

The system weighs approximately 236 pounds (107 kg) when fully equipped. A lifting device will be required to lift the system.

Ensure that doorways, corridors, and aisles are wide enough and high enough to accommodate the system while it is being moved by the lifting device.

1.2 Site Planning Checklist

1.2.1 Training

- Have system administrators and operators taken the necessary Sun Microsystems training courses?

1.2.2 System Components

- Has the system configuration been determined?
- What is the total number of systems?

1.2.3 Physical Specifications

- Has the system location been established?
- Does the equipment floor layout meet the equipment maintenance access requirements ([Section 2.3, “Service Access” on page 2-6](#))?
- Is the equipment positioned so that the exhaust air of one device does not enter the air inlet of another?

1.2.4 Environmental Requirements

- Does the computer room environment meet the temperature and humidity specifications ([Section 3.2, “Airflow and Heat Dissipation” on page 3-3](#))?
- Can the computer room environment specifications be maintained satisfactorily?
- Is additional fire suppression equipment required?

1.2.5 Facility Power Requirements

- Have you determined system cabinet and peripheral cabinet(s) voltage?
- Have sufficient power receptacles been ordered for each system, monitor, and peripheral?
- Are circuit breakers properly installed and labeled?
- Are the power receptacles within 11.5 feet (3.5 meters) of the server cabinet system, or within 6.0 feet (1.8 meters) of the standalone server system?

Physical Specifications

This chapter describes the physical specifications and accessibility considerations for Sun Fire V1280/Netra 1280 systems. It contains the following sections:

- [Section 2.1, “Dimensions” on page 2-1](#)
- [Section 2.2, “Mounting Requirements” on page 2-3](#)
- [Section 2.3, “Service Access” on page 2-6](#)
- [Section 2.4, “Seismic Applications” on page 2-6](#)

2.1 Dimensions

The depth given on [TABLE 2-1](#) does not include I/O connectors, power connectors, or cable management features.

Cables are likely to protrude a minimum of 1.2 in. (3 cm) from the rear of the system, and the telescopic slides protrude 1.1 in. (2.8 cm). The cable management arm could add between 2.4 in. to 7.9 in. (6 cm to 20 cm) to the system depth.

Power connectors could add 2 in. (5 cm) to the depth.

TABLE 2-1 shows the shipping dimensions of a Sun Fire V1280/Netra 1280 system.

TABLE 2-1 System Dimensions

Dimension		Measurement	
		Imperial	Metric
Width	Including slides	17.50 in.	44.50 cm
	Including mounting cradle	22.20 in.	56.48 cm
	Including wooden pallet	23.62 in.	60.00 cm
Depth	System only	22.00 in.	55.80 cm
	Including slides	22.40 in.	56.80 cm
	Including mounting cradle	22.00 in.	55.82 cm
	Including wooden pallet	27.76 in.	70.50 cm
Height	12RU nominal	21.00 in.	53.34 cm
	Including mounting cradle	25.30 in.	64.21 cm
	Including wooden pallet	36.97 in.	93.90 cm
Weight	system only	236.0 lbs	107 kg
	Including mounting cradle	286.0 lbs	130 kg
	Including cable management and slides	310.0 lbs	141 kg
Misc.	Opening in wooden pallet to accommodate lifting device (accepts standard cargo lifting devices)	24.60 in.	62.50 cm
	Opening in orange mounting cradle to accommodate lifting device	13.30 in.	33.70 cm

2.2 Mounting Requirements

Sun Fire V1280/Netra 1280 systems have been designed to accommodate the most common mounting configurations. The rackmount kit that ships with the system allows installation in the following racks:

- Sun Rack 900 Cabinet
- Sun Fire Cabinet
- Sun StorEdge™ Expansion Cabinet
- 19-inch IEC297/EIA310-D rack with a depth between mounting rails of 17.7 inches (45.00 cm) and 30.7 inches (78.00 cm).
- 19-inch two-post rack with a post depth of between 3 inches (7.62 cm) and 6 inches (15.24 cm).

An optional rackmount kit provides adapters to allow installation in a 23-inch two-post rack with a post depth of 5 inches (12.70 cm). These are intended for use with Telco unequal flange seismic frames.

Sun Fire V1280/Netra 1280 systems must be mounted using screws suitable for the equipment rack. The screws should be M5, M6, or no. 10-32 UNF (unified bolt threads fine). All screws must be fitted. The recommended tightening torque value for either M5 or no. 10-32 UNF recess head screws is 2.8 lb-f (3.8Nm), and that for M6 screws is 4.4 lb-f (6 Nm).

The vertical mounting hole pattern of the rack should conform to the standard dimensions shown in [FIGURE 2-1](#).

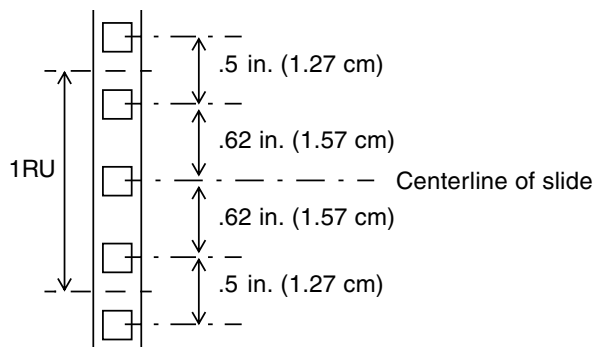


FIGURE 2-1 EIA/RETMA Universal Mounting Hole Pattern Dimensions

Ensure that the slides will fit the RETMA hole pattern so that the system, when installed, aligns with a RU (rack unit) boundary.

2.2.1 Vertical Space

Sun Fire V1280/Netra 1280 systems occupy 12 RU (21 in./53.34cm) of vertical height.

2.2.2 Depth

There must be a minimum of 22.44 inches (57.00 cm) usable internal depth in the rack or cabinet.

Required usable depth (rack internal space) is dependant upon the cooling airflow arrangement and the type of cable management used.

Examples of depth:

- Minimum = 22.44 inches (57.00 cm)

The cable management arm (CMA) must not be installed, and the front cabinet door must be removed (to provide maximum airflow) to achieve the minimum depth (cable support must be provided by the installer).

- Typical Lite = 25.3 inches (64.30 cm)

The CMA-lite cable management arm must be installed, and the front cabinet door must be ventilated with 1 inch (2.50 cm) of air plenum to achieve the typical lite depth.

- Typical = 30.8 inches (78.30 cm)

The CMA-800 cable management arm must be installed, and the front cabinet door must be ventilated with 1 inch (2.50 cm) of air plenum to achieve the typical depth.

- Maximum = 33.4 inches (84.80 cm)

The CMA-800 cable management arm must be installed, and the front cabinet door must be solid with a 3.54 inch (9.00 cm) plenum at the front of the system to act as a ventilation chimney. An inset to the front mounting rails of 4.5 inches (11.50 cm) is required.

2.2.3 Loading

The rack must be capable of supporting a static load of 236 pounds (107kg) for each fully configured Sun Fire V1280/Netra 1280 system installed. Dynamic load considerations are subject to site location and application specifications.

In a suitably stable four-post rack, two Sun Fire V1280/Netra 1280 systems can be fitted. Mounting hole information is provided in the *Sun Fire V1280/Netra 1280 Systems Installation Guide*.

No units or cables above or below a system should protrude beyond the front of the system to ensure system access when the slides are extended.



Caution – Never mount multiple systems in a two-post rack.

2.2.4 Safety

Sun strongly suggests that all host cabinets containing a Sun Fire V1280/Netra 1280 system be anchored to the floor, to the ceiling, or to adjacent frames, using the manufacturer's instructions.

Free standing cabinets should be supplied with an anti-tilt feature, which must sufficiently support the weight of the Sun Fire V1280/Netra 1280 system when extended on its slides (usually a minimum of 10.6 inches (27 cm) from the front edge of the rack). Where an anti-tilt feature is not supplied and the cabinet is not bolted to the floor, a safety evaluation must be conducted by the installation or service engineer to determine rack stability when the Sun Fire V1280/Netra 1280 system is extended on its slides.

Prior to installing the cabinet on a raised floor, a safety evaluation must be conducted by the installation or service engineer to ensure that the floor has sufficient strength to handle the Sun Fire V1280/Netra 1280 system when extended on its slides. In this case secure the rack through the raised floor to the concrete floor below using a proprietary rack-mounting kit for the purpose.



Caution – When multiple systems are fitted in a cabinet, only one system can be extended for service at any a time.

2.3 Service Access

When determining the final location of the Sun Fire V1280/Netra 1280 system, ensure there is enough space for service access. Allow a minimum of clearance of 35 inches (86.0 cm) at the front and rear of the system for service access.

The distance between cabinets can be zero. The last cabinet within any aisle should be a minimum of 36 inches (91.4 cm) from any data center equipment or dividing walls.

Note – Additional room on the right side of the system is desirable to improve access for I/O and IB-SSC service.

2.4 Seismic Applications

If the Sun Fire V1280/Netra 1280 system is used in an environment where Earthquake Zone 4 compliance is required, a rack designed to tolerate a Zone 4 earthquake must be selected, and independent tests undertaken to ensure system compliance in these areas.

A seismic rack should be rigid enough to result in a fundamental resonance in the horizontal axis of greater than 5 Hz with the Sun Fire V1280/Netra 1280 system installed.

Environmental and Electrical Specifications

This chapter describes the environmental and electrical requirements for Sun Fire V1280/Netra 1280 systems. It contains the following sections:

- Section 3.1, “Environmental Requirements” on page 3-1
- Section 3.2, “Airflow and Heat Dissipation” on page 3-3
- Section 3.3, “Sun Fire V1280 System Power Requirements” on page 3-4
- Section 3.4, “Netra 1280 System Power Requirements” on page 3-6

3.1 Environmental Requirements

The system can be installed in an environment with the specific operating ranges shown in [TABLE 3-1](#).

The design of your environmental control system—such as computer room air-conditioning units—must ensure that intake air to the server system complies with the limits specified in this section.

To avoid overheating:

- Guard against directing any warm air toward the front of the cabinet.
- Guard against directing warm air toward the system access panels.

[TABLE 3-1](#) lists the environmental limits for Sun Fire V1280/Netra 1280 systems.

TABLE 3-1 Environmental Limits for Sun Fire V1280/Netra 1280 Systems

Environmental Factor	Operating Range	Non-Operating Range	Optimum
Ambient temperature*	41° to 95°F (5° to 35°C) up to 550 yards (500 meters) ^d	-40° to 149°F (-40° to 65°C*)	69.8° to 73.4°F (21° to 23°C*)
Relative humidity\	10 to 90% non condensing 80.6° (27°C) maximum wet bulb	10 to 90% nonconducting 100.4° (38°C) maximum wet bulb	45 to 50% non condensing
Elevation	For UltraSPARC IV+ 1.8 GHz CPU/Memory boards only, maximum 7000 feet (2134 meters) All other CPU/Memory boards, maximum 10000 feet (3048 meters)	maximum 39400' feet (12000 meters)	

In addition to the above environmental conditions, the Netra 1280 complies with the requirements of Telcordia SR-3580 (NEBS) Level 3.

* Does not apply to removable media devices.

\ Subject to a maximum absolute humidity of 0.024 kg of water per kg of dry air.

^d Maximum ambient operating temperature is derated by 1 degree C per 500m elevation.

The operating environmental limits in [TABLE 3-1](#) reflect systems testing. The optimum condition is the suggested operating environment. Operating computer equipment for extended periods at or near the temperature or humidity extremes is known to significantly increase the failure rate of hardware components. It is strongly suggested that customers plan and use the optimal temperature and humidity ranges in order to minimize any chance of downtime due to component failure.

3.1.1 Ambient Temperature

The ambient temperature range of 69.8° to 73.4°F (21°C to 23°C) is optimal for system reliability and operator comfort levels. Most computer equipment can operate within a wide temperature range, but a level near 71.6°F (22°C) is desirable because it is easier to maintain safe associated relative humidity levels at this temperature. Operating in this temperature range provides a safety buffer in the event the environmental support systems go down for a period of time. Though individual standards vary slightly, 69.8° to 73.4°F (21°C to 23°C) should be used as an optimal setting.

3.1.2 Ambient Relative Humidity

The ambient relative humidity levels between 45 percent and 50 percent are the most suitable for safe data processing operations. Under certain circumstances, most data processing equipment can operate within a fairly wide environmental range (20 percent to 80 percent), but the optimal goal should be between 45 percent to 50 percent for the following reasons:

- Optimal range helps protect computer systems from corrosivity problems associated with high humidity levels.
- Optimal range provides the greatest operating time buffer in the event of environmental control system failure.
- This range helps avoid failures or temporary malfunctions caused by intermittent interference from static discharges that might occur when relative humidity is too low.

Electrostatic discharge (ESD) is easily generated and less easily dissipated in areas where the relative humidity is below 35 percent. ESD becomes critical when levels drop below 30 percent. The 5 percent relative humidity range might seem unreasonably tight when compared to the guidelines used in typical office environments or other loosely controlled areas; where as, it is not as difficult to maintain in a data center because of the high efficiency vapor barrier and low rate of air changes normally present.

3.2 Airflow and Heat Dissipation

The maximum rate of heat release from a Sun Fire V1280/Netra 1280 system with all slots occupied and active is 3300 W (11300 British Thermal Units (BTU) per hour). [TABLE 3-2](#) shows detailed figures.

TABLE 3-2 Heat Dissipation

Configuration	Heat Dissipation	
	Sun Fire V1280	Netra 1280
4 CPUs, 8 Gbytes memory	1400W (4780 BTU/hr)	1500W (5120 BTU/hr)
8 CPUs, 16 Gbytes memory	2150W (7330 BTU/hr)	2310W (7880 BTU/hr)
12 CPUs, 24 Gbytes memory	2900W (9890 BTU/hr)	3120W (10640 BTU/hr)
12 CPUs, 96 Gbytes memory	3300W (11300 BTU/hr)	3530W (12030 BTU/hr)

The Sun Fire V1280/Netra 1280 system has been designed to function while mounted in a natural convection airflow. The following rules must be followed to meet the environmental specification.

- Ensure adequate airflow through the system. The Sun Fire V1280/Netra 1280 system uses internal fans that can achieve a total airflow of 400 cubic feet of air per minute (cfm) in normal operating conditions.
- The system has front-to-back cooling. The air inlet is at the front of the system. The exhaust exits from the rear of the system.
- Ventilation openings for both the inlet and exhaust of the system should provide a minimum open area of 160 inches² (1030 cm²) each.
- Allow a minimum of clearance of 35 inches (86 cm) at the front and rear of the system for adequate ventilation.
- Ensure that additional equipment installed in the cabinet does not exceed environmental limits at the air inlet. The environmental limits assume the system is operating in the system cabinet with ventilated doors closed.

3.3 Sun Fire V1280 System Power Requirements

The Sun Fire V1280 system is supplied ready for installation in an equipment rack.

Note – The voltage must be in the range 200–240VAC for the system to power up.

The Sun Fire V1280 system is supplied with four detachable power cords fitted with wall plugs to mate with the local electrical socket outlets. [TABLE 3-3](#) shows the power cord ratings.

Note – The plug at the end of each power cord is the primary means of disconnection for this product.

TABLE 3-3 Sun Fire V1280 System AC Power Cord Ratings

Rating	Value
Voltage	200 to 240 VAC
Maximum input current per cord	9A at 200 VAC
Line cord	10A nominal
Circuit breakers – North America (4)	15A to 20A
Circuit breakers – international (4)	16A

[TABLE 3-4](#) shows the on-site AC power requirements.

TABLE 3-4 Sun Fire V1280 System Power Requirements

Rating	Value
Voltage	200–240 VAC
Frequency	50–60 Hz

[TABLE 3-5](#) shows the current and power consumption of the Sun Fire V1280 system at 200 VAC.

TABLE 3-5 Sun Fire V1280 System Current and Power Consumption

Rating	Value
Current	9A per cord, if only two cords are powered
Inrush Current	18A after 100 μ s
Surge Current	After 5ms brown-out short term surge is higher at 75A
Power Consumption	3300W max. total

3.3.1 Grounding Requirements

The Sun Fire V1280 system enclosure has an additional safety earth bonding point.

This bonding point must meet the central office requirements for enclosure or shelf grounding in GR1089-CORE. This is for a path between the unit system and enclosure metal or nearby point on the central office ground system.

The use of this bonding point connection is optional and is generally dependent on the equipment practice of the installer.

This bonding point is independent of the safety ground connection for the power system grounding, which is provided by the earth wire present in each of the power cords. This connection must be present.

3.3.2 Connecting AC Power for Redundancy



Caution – For optimum redundancy, the power cords should be connected to two independent power sources (two power cords for each power source).

Most commonly, two independent power sources means an outside power line as one source and an uninterruptible power supply backup system (UPS) as the second source. That way, if a single power source should fail, the system will continue to function.

Each power cable should have its own circuit breaker.

The system will not enter standby unless two system power supplies have in range AC inputs.

3.4 Netra 1280 System Power Requirements

The Netra 1280 system is supplied ready for installation in an equipment rack.



Caution – This system has multiple power connections. You must open all associated circuit breakers in order to completely remove power from the system.

Note – The voltage must be in the range -40 to -72 VDC for the system to power on.



Caution – The power switch is not an On/Off switch. This power switch is an On/Standby switch. It does not isolate the equipment. The circuit breakers are the primary means for isolating the Netra 1280 system.

The power switch of the Netra 1280 system is a rocker style momentary action switch. This switch controls only low voltage signals. No high voltage circuits pass through this switch.

At least two dedicated power sources should be provided with positive-ground circuit breakers, see [Section 3.4.2, “Connecting DC Power for Redundancy” on page 3-9](#) for details. Connector lugs are provided for crimping on to customer-supplied cables.

The Netra 1280 system is supplied with connections for four feed pairs. [TABLE 3-6](#) shows the feed-pair current ratings.

TABLE 3-6 Netra 1280 System DC Feed Pair Ratings

Rating	Value
Voltage	-40 to -72 VDC
Maximum input current per feed pair at -48 VDC	38A
Maximum input current per feed pair at -40 VDC	47A
Power supply wiring rating	47A
Circuit breaker panel	50A

Note – In North America, 90 degrees C 6 AWG copper conductors must be used. Where other codes apply, 10 mm² copper conductors must be used.

[TABLE 3-7](#) shows the current and power consumption of the Netra 1280 system at -48 VDC.

Note – The circuit breakers are the primary means of disconnection for this product.

TABLE 3-7 Netra 1280 System Current and Power Consumption

Rating	Value
Current at -48 VDC	38A per feed pair, if only two feed pairs are powered*
Inrush Current	< 70A for < 100ms
Surge Current	After a brown-out of up to 75 ms, short term surge is < 150A for a maximum of 4 ms, linearly decaying to the normal running current in less than 10 ms (FIGURE 3-1).
Power Consumption	3530W maximum total split across two or more power feed pairs. Less than 1900W for a single power supply feed pair.

* The worst case input current for each power supply is drawn when only two of the four power supplies have supplied power. If the supply voltage is below -48V, then the current rises to a maximum of 47A.

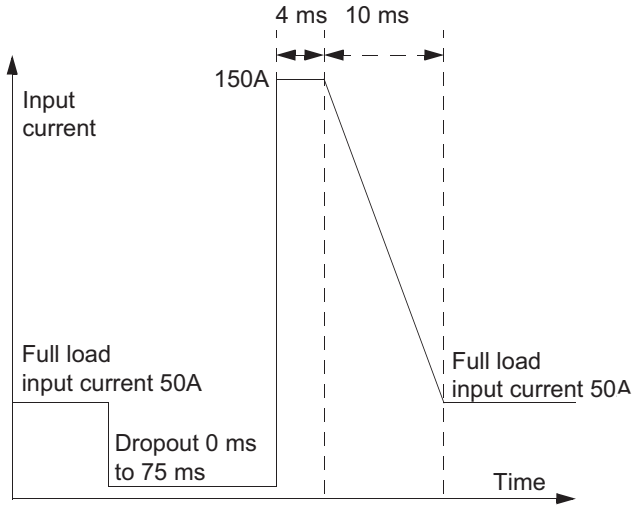


FIGURE 3-1 Surge Current

3.4.1 Source Site Requirements

The DC source must be:

- -48 VDC or -60 VDC nominal centralized DC power system
- Electrically isolated from any AC power source
- Reliably connected to earth (the battery room positive bus is connected to the grounding electrode)
- Rated for a minimum of 50A per feed pair

Note – The Netra 1280 system must be installed in a restricted access location. The IEC, EN and UL 60950 define a restricted access location as an area intended for qualified or trained personnel only with access controlled by a locking mechanism such as a key lock or an access card system.

3.4.1.1 Grounding Requirements

The Netra 1280 system enclosure has an additional safety earth bonding point. This bonding point must meet the central office requirements for enclosure or shelf grounding in GR1089-CORE. This is for a path between the unit system and enclosure metal or nearby point on the central office ground system. The use of this bonding point connection is optional and is generally dependent on the equipment practice of the installer.

This is independent of the safety ground connection for the power system grounding, which is provided by the two-hole connection on the DC inlet module.

3.4.1.2 Overcurrent Protection Requirements

Overcurrent protection devices must be provided as part of each host equipment rack.

- Four 50A single-pole, fast trip, DC-rated circuit breakers (one per ungrounded supply conductor) must be located in the negative supply conductor between the DC power source and the Netra 1280 system.
- Circuit breakers must not trip when presented with inrush current of 60A lasting 200 ms.

Note – Overcurrent devices must meet applicable national and local electrical safety codes and must be approved for the intended application.

3.4.1.3 Disconnection and Isolation

The disconnect devices for servicing are defined as the circuit breakers in all negative supply conductors.

3.4.2 Connecting DC Power for Redundancy



Caution – For optimum redundancy, the feed pairs should be connected to two independent power sources (two feed pairs to each power source).

Most commonly, two independent power sources means an outside power line as one source and an uninterrupted power supply backup system (UPS) as the second source. That way if a single power source should fail, the system will continue to function.

Each power cable should have its own circuit breaker.

